

NOTE:

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES, SEE DWG E-1.
2. FOR SMOKE DETECTOR INSTALLATION DETAILS, SEE DWG E-17.
3. FOR SMOKE DETECTION/FIRE ALARM HVAC SHUTDOWN SCHEDULE, SEE DWG E-18. THIS SCHEDULE IS FOR INFORMATION ONLY AND REPRESENTS NO WORK TO THIS CONTRACTOR.
4. ALL ADDRESSABLE SMOKE DETECTOR CIRCUITS RUN TO EXISTING ATC CABINET IN JANITORS CLOSET.
5. REMOVAL OF OLD SMOKE DETECTORS AND PATCHING AS PER INDICATED PATCHING DETAIL NUMBER NEXT TO THE OLD SMOKE DETECTOR WILL BE MADE BY OTHERS.
6. FOR REMOVAL AND PATCHING PLAN DETAILS (P-1, P-2, P-3 & P-4), SEE DWG A-1.
7. FOR EXACT LOCATION, SEE MECHANICAL REFERENCE DWG M-A-70.

Sheet 15 of 21



THE PORT AUTHORITY
OF NY & NJ

Peter K. Shuman
ENGINEERING PROGRAM MANAGER
B. Feldstein
CHIEF ELECTRICAL ENGINEER

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. 17-1006-15-10 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 7-15-97 *Peter K. Shuman* SPEC. WRITER
DATE 7/18/97 *Peter K. Shuman* ENGINEER OF DESIGN

No. Date Revision Approved

Engineering Department
Design Divisions


The World Trade Center

Title
**FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III**
ELECTRICAL
**1 WTC
72nd FLOOR
SMOKE DETECTOR INSTALLATION
AND REMOVAL PLAN**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S. FELDSTEIN B. FALDU
Designed by Drawn by Checked by

Date 2/4/97 Scale AS SHOWN
Contract Number Drawing Number
WTC-861.077 E-14

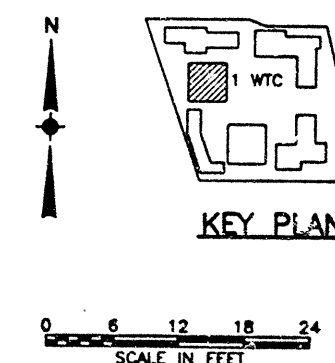

FILE NAME: J:\CIVIL\861.077\72SMOKE.DWG 17/2/1996 15:10 Bharat Tanna, P.A. of NY & NJ